

LCU: Precedent and Voyager 2 System Monitoring Controls Options changes



eTPB2019 | August 14, 2020

•Options for Econ FDD (non Title 24 compliant) and FDD & DCV (non Title 24 compliant) in digit 26 are discontinued in TOPSS and Job Center.

–To get the TD5 Human Interface, select Advanced Unit Controls in digit 31.

–This change is effective with replication 238.

Why it's Happening:

•This clarifies selections and notes.


–FD&D with the TD5 Human Interface is not T24 compliant. It may satisfy AHRAE 90.1 or IECC 2015 if the TD5 is remotely located inside the building.

–A BMS or BAYSENS924* with Bacnet will satisfy FD&D code requirements.

How this Affects the Field:

-Going forward, select the Advanced Unit Controls in digit 31.

-LLE in the fresh air selection must be selected when FDD is required.

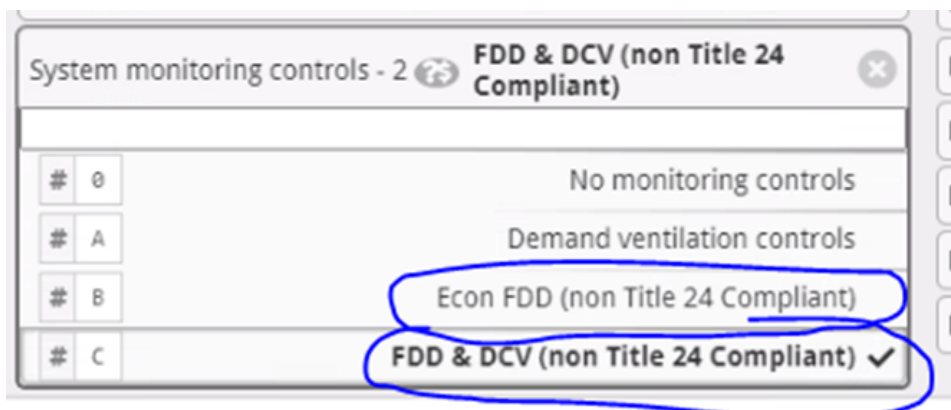

Questions?

Contact [Product Support](#)